

Eastman copolyesters Effect of outdoor exposure

Like many plastics, Eastman copolyesters are sensitive to outdoor exposure. Long-term exposure to ultraviolet (UV) rays in sunlight can adversely affect performance of these copolyesters in the following ways.

- Color—shift to yellow
- Durability—decrease in impact resistance
- Transparency—increase in haze


Because prolonged outdoor exposure to direct sunlight can reduce the lifetime of an application, Eastman copolyesters are not recommended for continuous outdoor use unless protected from UV light. Similar to other plastics (including polycarbonate), this UV protection typically involves the addition of a UV inhibitor to the formulation or a UV cap layer.

The following charts show the effect of UV sunlight on PET, polycarbonate, and Eastman Tritan™ copolyester. These data were obtained on specimens cut from extruded sheet and tested on Atlas Ci65A xenon arc accelerated weathering


machines according to ASTM Practice G155 cycle 1 and ASTM D2565 using borosilicate inner and outer filters. Samples were removed periodically and tested for Delta E color difference (ASTM D2244) and impact strength (ASTM D6395). The “% retention of toughness” was calculated as the impact strength of the exposed sample divided by the impact strength of the unexposed sample.

Note that these machines are designed to greatly accelerate the effect of UV exposure, which is why the properties shown here change very rapidly. Each 500 kJ/m²/nm@340nm of machine exposure might be roughly equivalent to 5–30 weeks of actual outdoor exposure, depending on many factors, including time of year, degree of sunshine, global location, and conditions of use.


Effect of UV exposure on Delta E of extrusion blow molded bottles

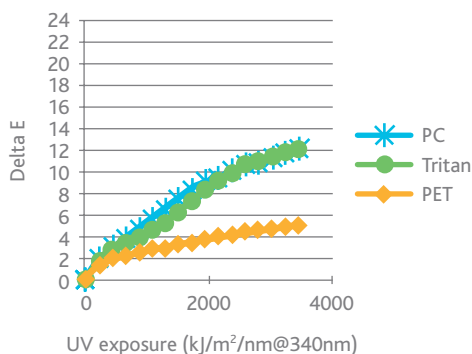


Effect of UV exposure on retention of toughness of extrusion blow molded bottles

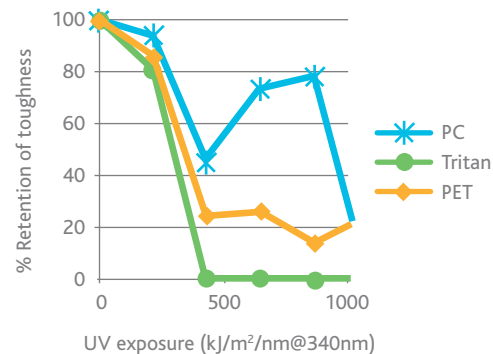

Effect of UV exposure on Delta E of extruded sheet

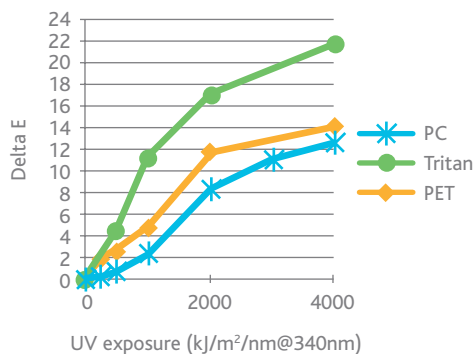

Effect of UV exposure on retention of toughness of extruded sheet

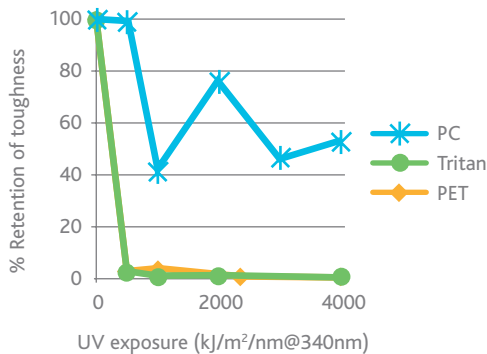

The impact of prolonged UV exposure will vary by individual application, with product design, gauge, and durability expectations being variables to consider. Eastman does not know this weathering testing represents conditions for all applications, so perform necessary testing to ensure acceptable performance over the life of the applications.

UV inhibitors can be used to improve the weathering performance of Eastman Tritan™ copolyester, however testing

is needed to determine the correct inhibitor and loading level needed to meet the fitness-for-use requirements of an application. In addition, UV resistant coatings or cap layers are also available for copolyesters used in outdoor signs and other film and sheet applications. As with any application, the fitness-for-use requirement must be evaluated in each case to ensure success. Contact an Eastman representative if you have any questions.



The results of insight™

**Eastman Chemical Company
Corporate Headquarters**

P.O. Box 431
Kingsport, TN 37662-5280 U.S.A.

Telephone:
U.S.A. and Canada, 800-EASTMAN (800-327-8626)
Other Locations, (1) 423-229-2000
Fax: (1) 423-229-1193

www.eastman.com

Safety Data Sheets providing safety precautions that should be observed when handling and storing Eastman products are available online or by request. You should obtain and review the available material safety information before handling any of these products. If any materials mentioned are not Eastman products, appropriate industrial hygiene and other safety precautions recommended by their manufacturers should be observed.

It is the responsibility of the medical device manufacturer ("Manufacturer") to determine the suitability of all component parts and raw materials, including any Eastman product, used in its final product to ensure safety and compliance with requirements of the United States Food and Drug Administration (FDA) or other international regulatory agencies.

Eastman products have not been designed for nor are they promoted for end uses that would be categorized either by the United States FDA or by the International Standards Organization (ISO) as implant devices. Eastman products are not intended for use in the following applications: (1) in any bodily implant applications for greater than 30 days, based on FDA-Modified ISO-10993, Part 1, "Biological Evaluation of Medical Devices" tests (including any cosmetic, reconstructive, or reproductive implant applications); (2) in any cardiac prosthetic device application, regardless of the length of time involved, including, without limitation, pacemaker leads and devices, artificial hearts, heart valves, intra-aortic balloons and control systems, and ventricular bypass assisted devices; or (3) as any critical component in any medical device that supports or sustains human life.

For manufacturers of medical devices, biological evaluation of medical devices is performed to determine the potential toxicity resulting from contact of the component materials of the device with the body. The ranges of tests under FDA-Modified ISO-10993, Part 1, "Biological Evaluation of Medical Devices" include cytotoxicity, sensitization, irritation or intracutaneous reactivity, systemic toxicity (acute), subchronic toxicity (subacute), implantation, and hemocompatibility. For Eastman products offered for the medical market, limited testing information is available on request. The Manufacturer of the medical device is responsible for the biological evaluation of the finished medical device.

The suitability of an Eastman product in a given end-use environment is dependent on various conditions including, without limitation, chemical compatibility, temperature, part design, sterilization method, residual stresses, and external loads. It is the responsibility of the Manufacturer to evaluate its final product under actual end-use requirements and to adequately advise and warn purchasers and users thereof.

© 2013 Eastman Chemical Company. Eastman, The results of insight, and Tritan are trademarks of Eastman Chemical Company.